



| REVISIONS | | | |
|-----------|-------------------|------|----------|
| REV | DESCRIPTION | DATE | APPROVED |
| 0 | ISSUED FOR REVIEW | | |

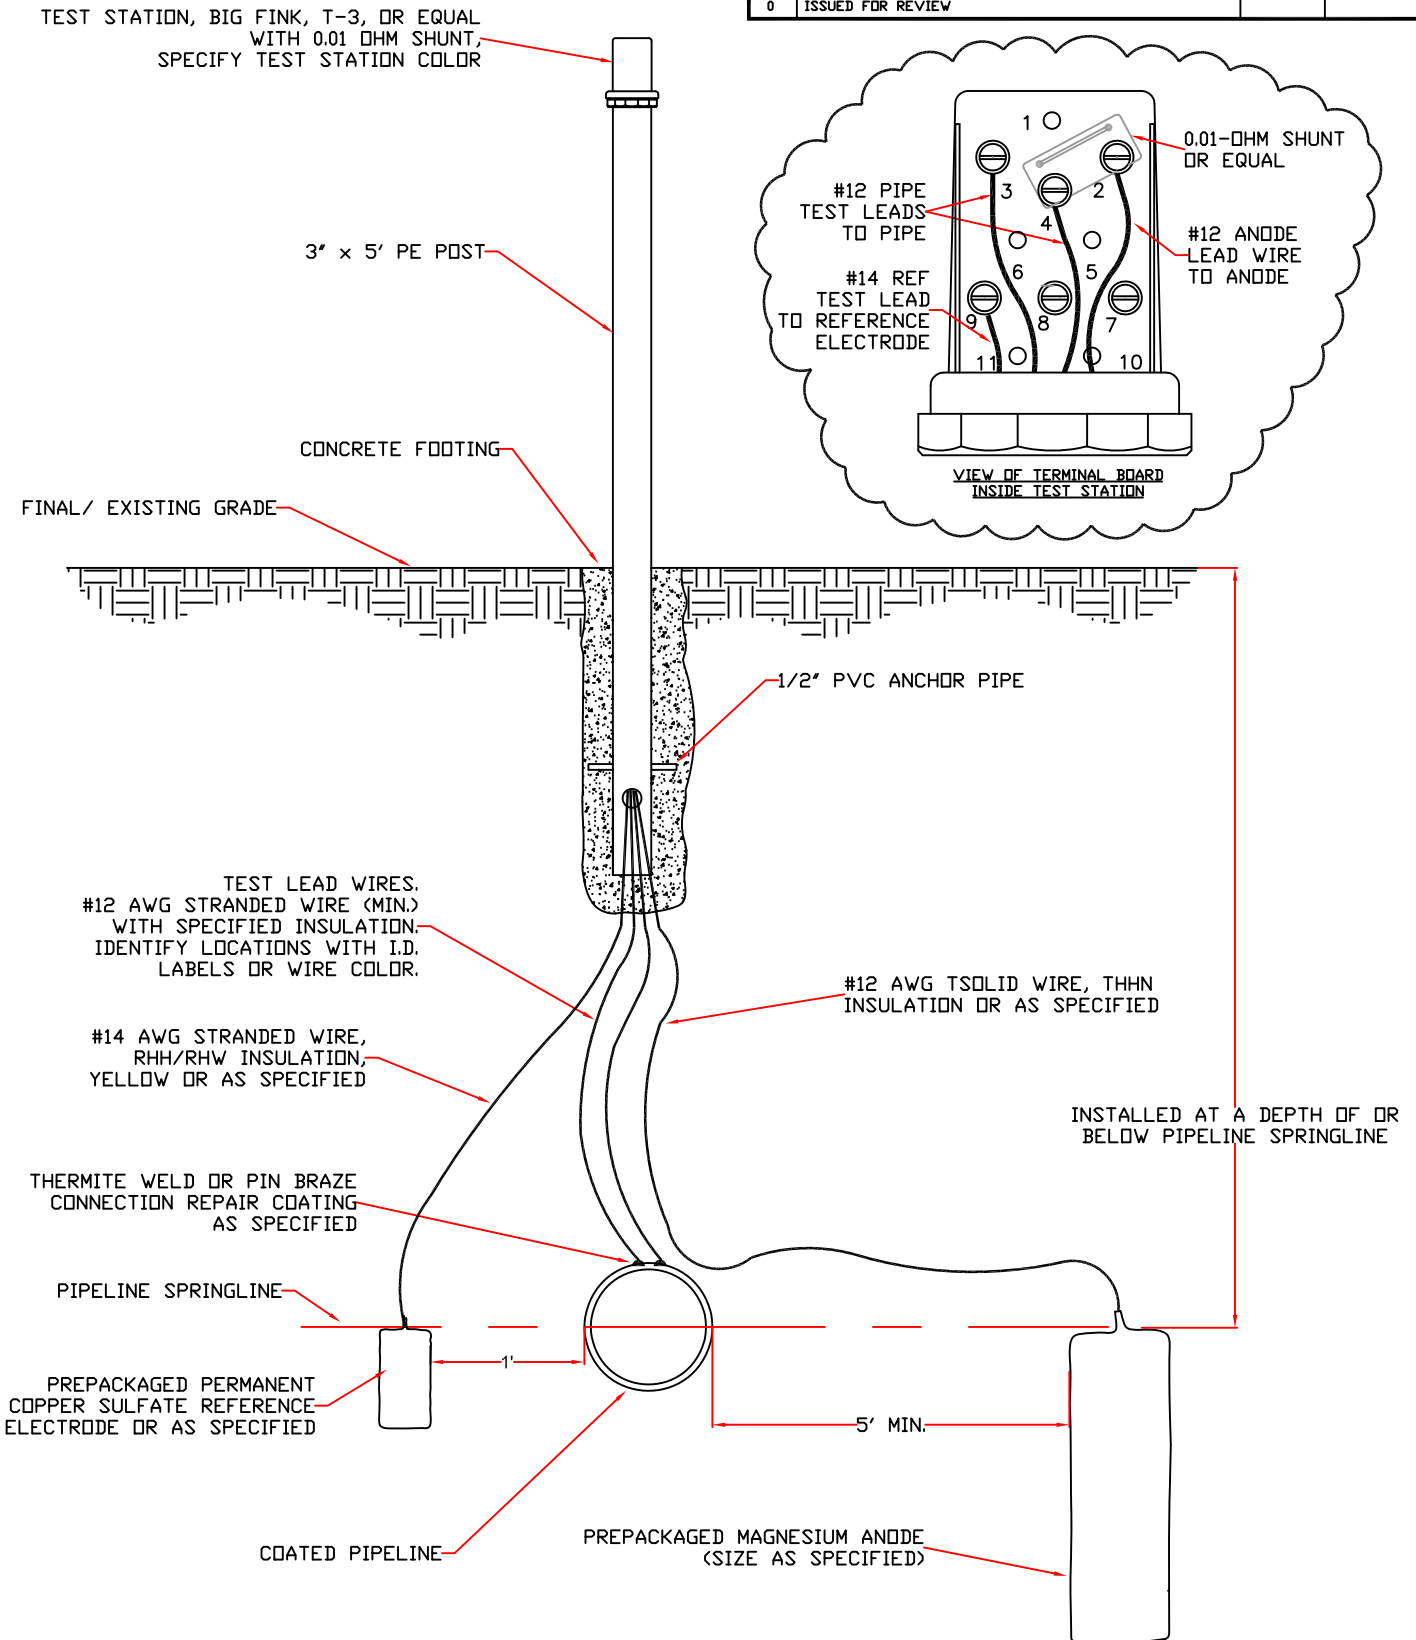

| | | | |
|---|--|---------------------|-----------------|
| DRAWN BY T.S.H. 12/08 ENGINEER | FARWEST CORROSION CONTROL COMPANY 1480 W. Artesia Blvd. Gardena, California | | |
| JOB NO. | TYPICAL CATHODIC PROTECTION SINGLE MAG. ANODE TEST STATION WITH COPPER SULFATE REFERENCE | | |
|  | SIZE A | DWG NO. S-4B-CCS | |
| | FILE S-4B-CCS | SCALE NONE | REV 0 |
| | | | SHEET 1 of 1 |