


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
0	ISSUED FOR REVIEW		

CONCRETE TEST BOX WITH CAST IRON LID, 2'x2'x4" CONCRETE PAD

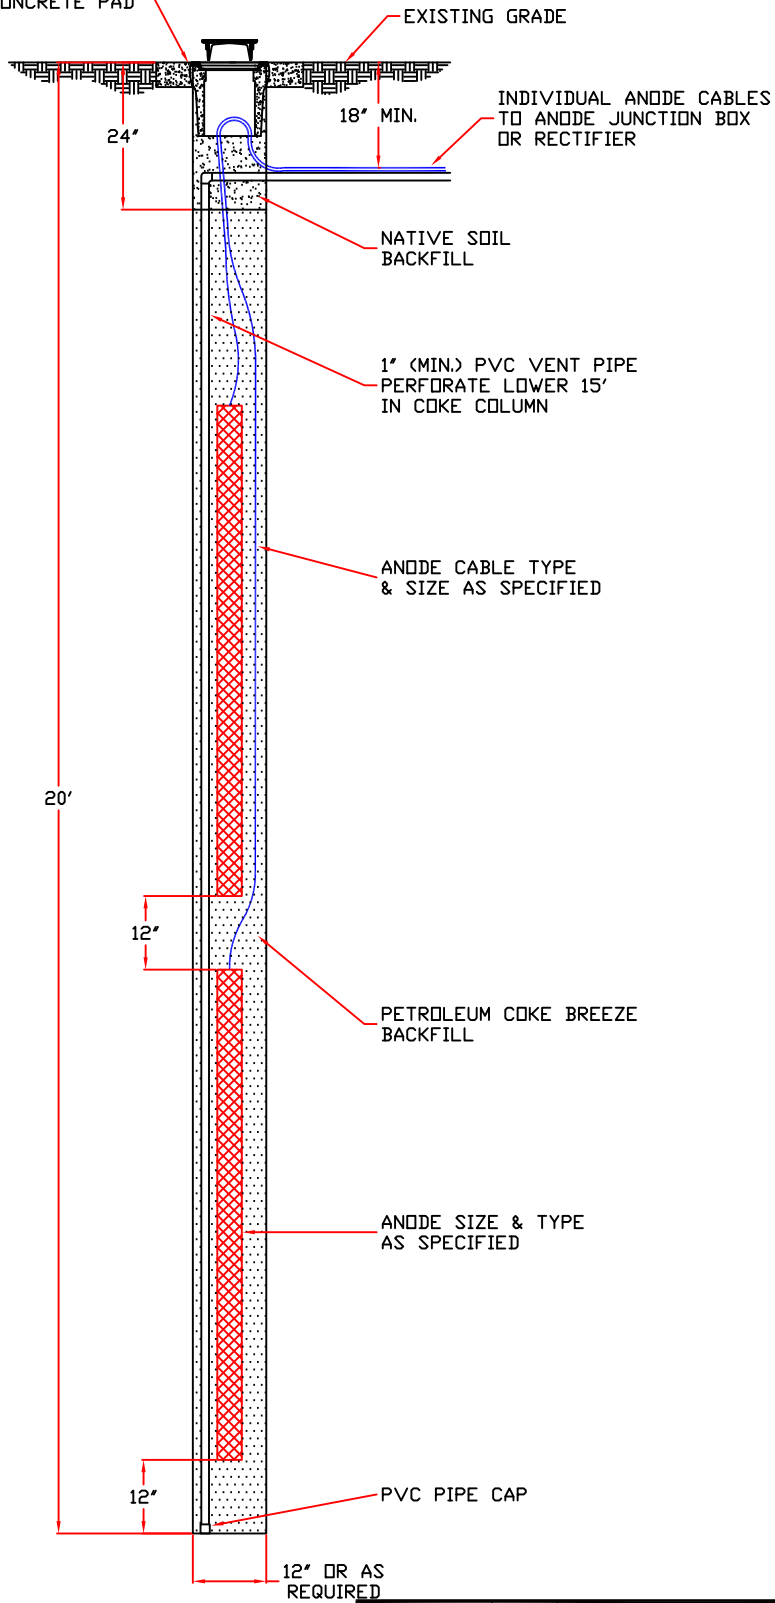

DRAWN BY T.S.H. 3/09
ENGINEER

JOB NO.



FARWEST CORROSION CONTROL COMPANY
1480 W. Artesia Blvd. Gardena, California

TYPICAL CATHODIC PROTECTION
20' SEMI-DEEP DUAL ANODE
INSTALLATION

SIZE
A

DWG NO.
S-5L

FILE
S-5L

SCALE
NONE

REV
0

SHEET
1 of 1